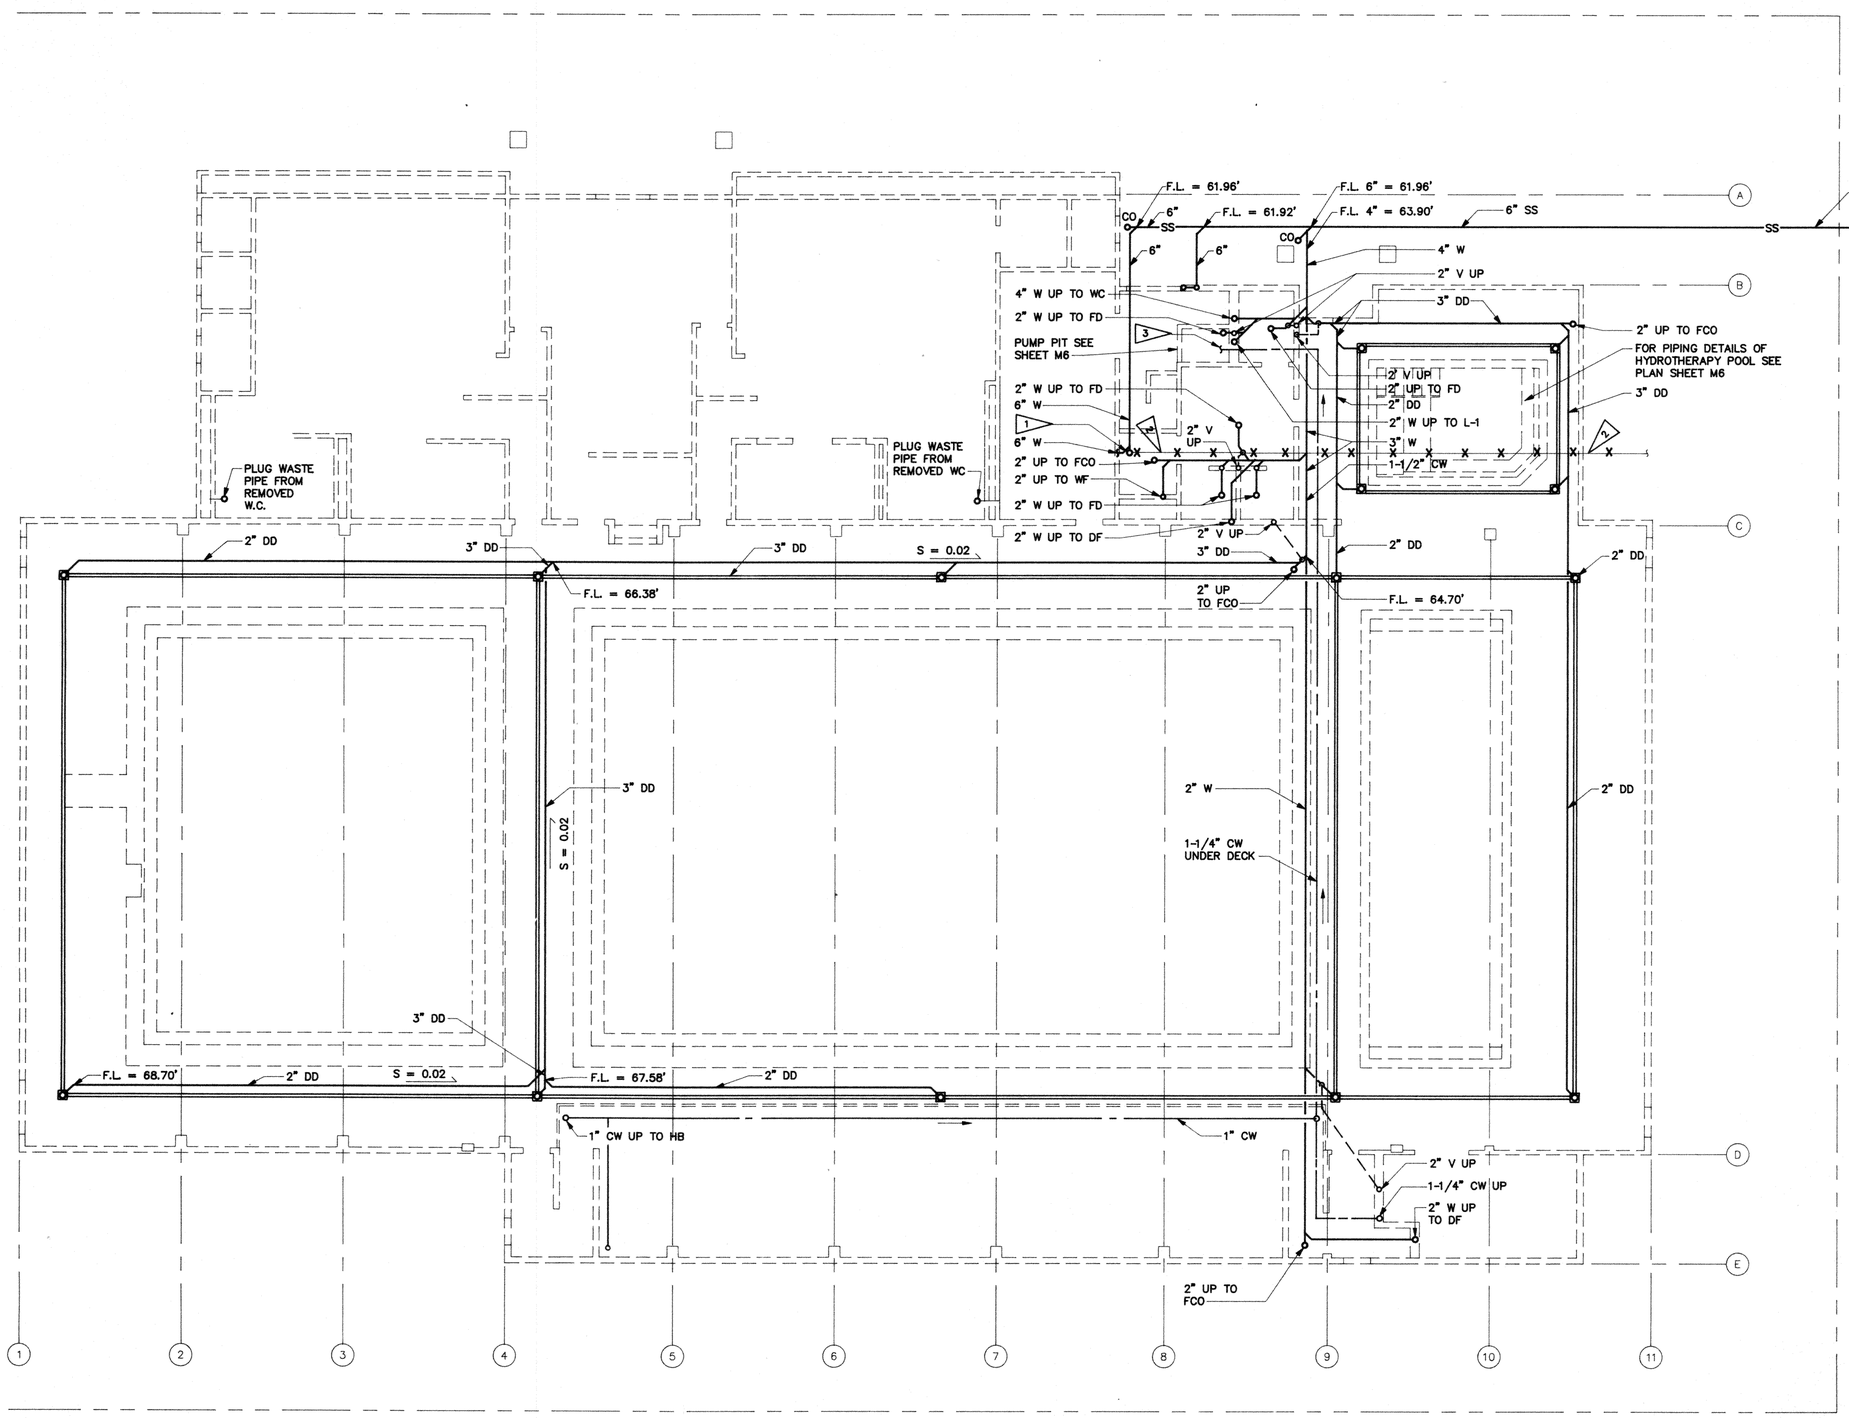

FOUNDATION PLAN

SCALE: 1/8" = 1'-0"

NOTES :

1. PROVIDE 6" W PIPE FOR EXISTING SWIMMING POOL FILTER SYSTEM BACKWASH DISCHARGE, BALANCING TANK OVERFLOW, AND OTHER SANITARY WASTE PIPES THAT ARE SERVED BY WASTE PIPE WITH EXPOSED CLEANOUT LOCATED APPROXIMATELY AS SHOWN. CONNECT NEW 6" W TO EXISTING W PIPES AT EXISTING FOUNDATION WALL LINE AND AS REQUIIRED TO SERVE THE WASTE STREAMS. PROVIDE 4" CLEANOUT IN ROOM 109.
2. REMOVE EXISTING WASTE PIPE AS REQURED AND PLUG AT END OF ABANDONED PIPE MINIMUM 2" BELOW FLOOR.
3. SLOPE 1-1/4" CW PIPE TO DRAIN COMPLETELY TO DRAIN VALVEW IN PUMP PIT. GRADE PIPE EVENLY ALL THE WAY TO THE DF, HB's, AND WH's IT SERVES.

GENERAL NOTES :

1. SEE SURVEY SHEET A1.0 FOR EXISTING UTILITY DATA, EXISTING ELEVATIONS, AND REFERENCE BENCH MARK.

MARK E. KINNER — STATE OF WASHINGTON — REGISTERED PROFESSIONAL ENGINEER

AMERICAN INSTITUTE OF ARCHITECTS

abacus CONSULTANTS, P.S.
318 occidental avenue south suite 200
seattle, washington 98104 (206) 583-0200

HAL MOE POOL ENCLOSURE

FOUNDATION PLAN

THE TSANG PARTNERSHIP, INC.
☐ SEATTLE ☐ TACOMA
1221 SECOND AVENUE SUITE 330 SEATTLE, WA 98101 (206) 343-3044 FAX (206) 684-9599
748 MARKET STREET SUITE 300 TACOMA, WA 98402 (206) 272-4303 FAX (206) 383-9059

DATE: 8-7-89

REVISED:

SHEET NO.: M2

© COPYRIGHTS RESERVED