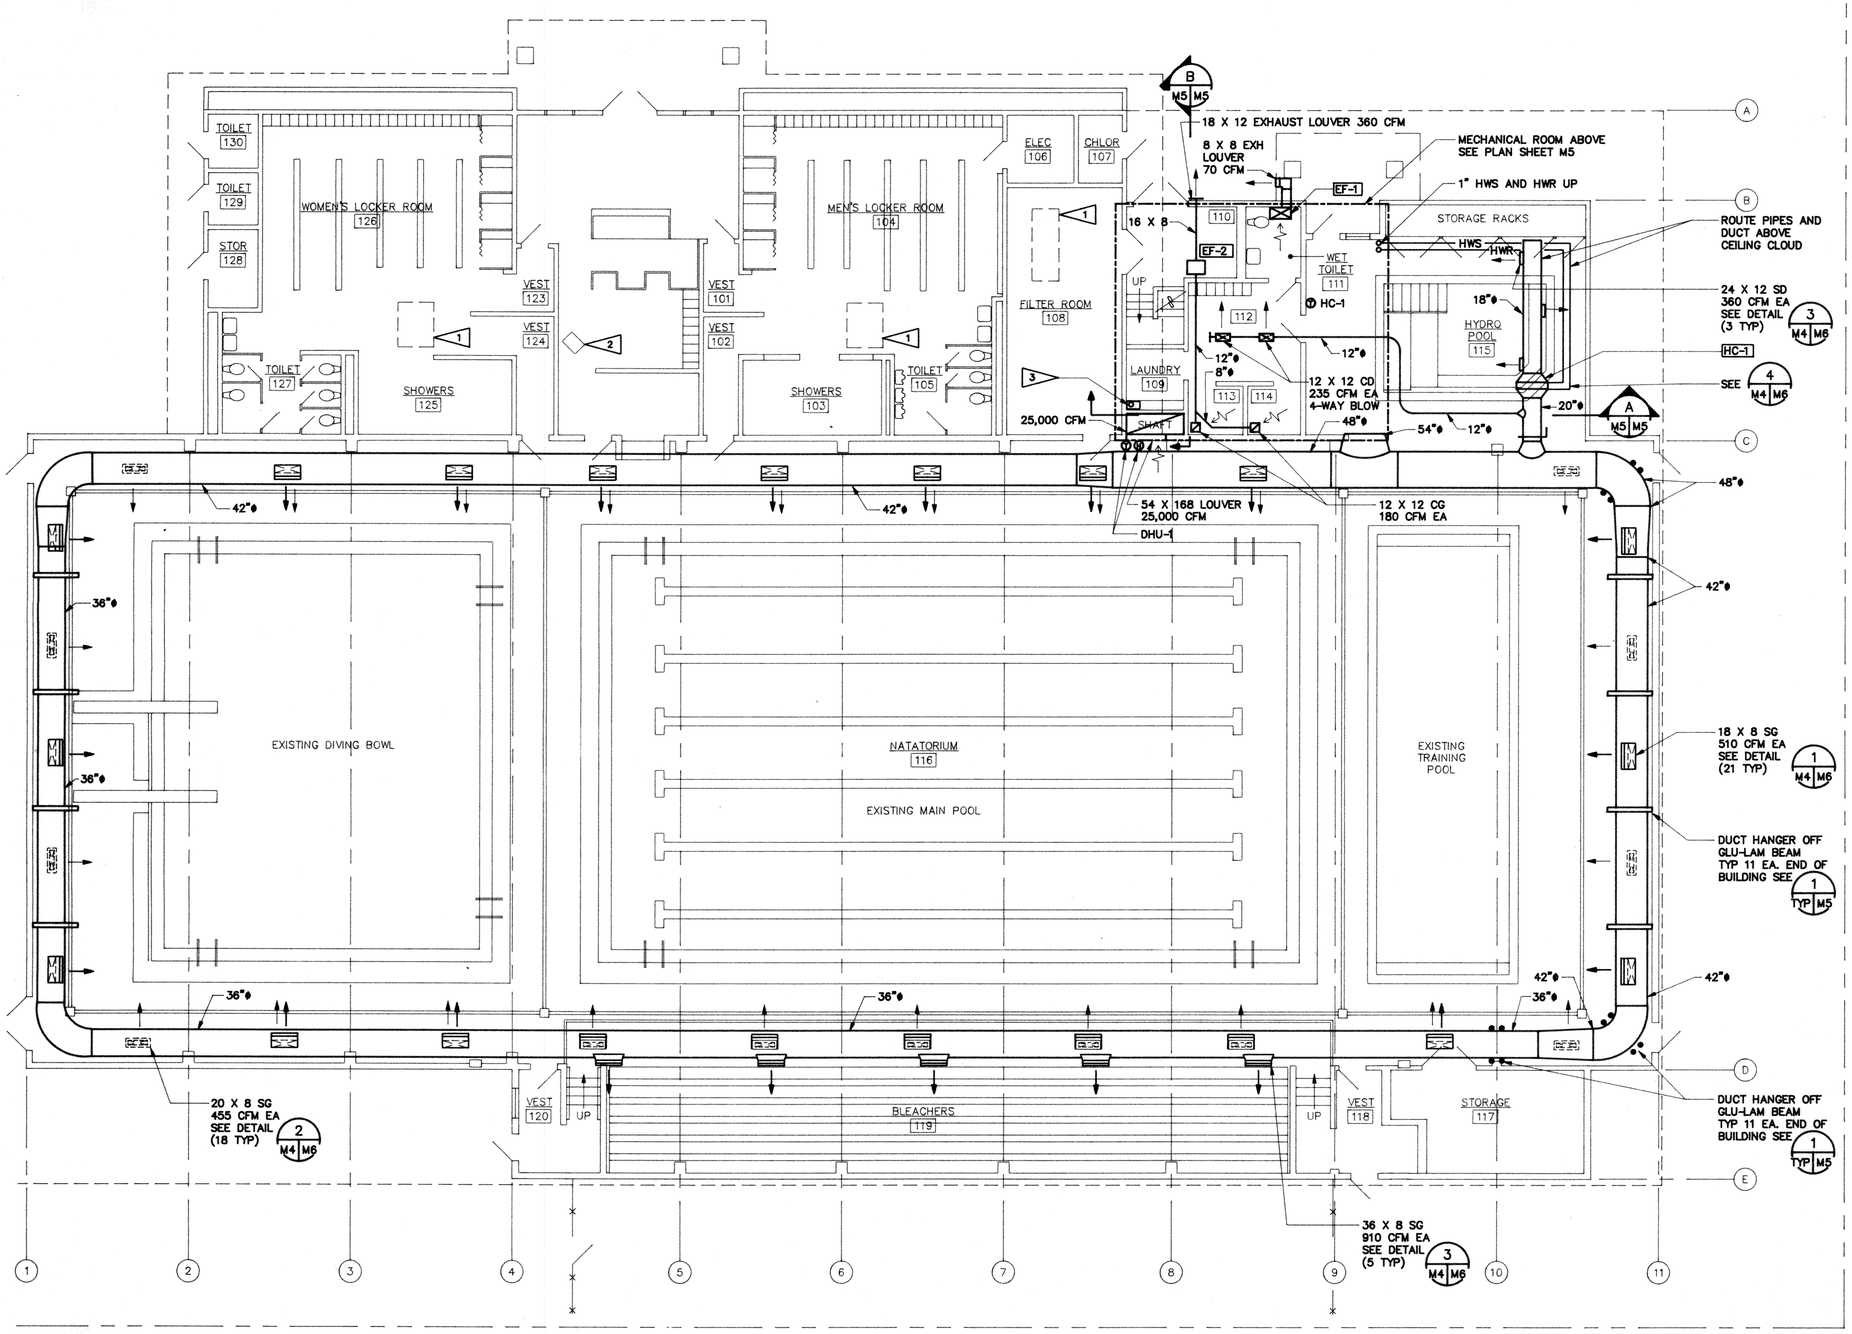

HVAC FLOOR PLAN

SCALE: 1/8" = 1'-0"

MARK E. KINZER — STATE OF WASHINGTON — REGISTERED PROFESSIONAL ENGINEER

AMERICAN INSTITUTE OF ARCHITECTS

abacus CONSULTANTS, P.S.
316 occidental avenue south suite 200
seattle, washington 98104 (206) 583-0200

NOTES :

1. EXISTING GAS FIRED ROOF TOP H AND V EQUIPMENT SHALL BE SERVICED AND RESTORED TO CORRECT OPERATION BY OWNER. NEW BURNER REPLACEMENT ELEMENTS ARE REPORTEDLY STORED IN ROOM 106.
2. EXISTING CEILING HUNG H AND V UNIT SHALL BE SERVICED FOR CORRECT OPERATION BY OWNER.
3. ROUGH-IN 6"ø DRYER VENT TO OWNER REQUIREMENTS GUY GRAY CO. MODEL CV-4 CLOTHES DRYER VENT ASSEMBLY. ROUTE UP THRU MECH RM AND OUT WEST WALL THRU 12 X 12 EXHAUST LOUVER.

HAL MOE POOL ENCLOSURE

HVAC PLAN

THE TSANG PARTNERSHIP, INC.
☐ SEATTLE ☐ TACOMA
1221 SECOND AVENUE SUITE 330 SEATTLE, WA 98101 (206) 343-3044 FAX (206) 684-9599
748 MARKET STREET SUITE 300 TACOMA, WA 98402 (206) 272-9383 FAX (206) 383-9059

DATE: 8-7-89

REVISED:

SHEET NO.: M4

© COPYRIGHTS RESERVED